

Number	25-001320-PR01 (NW T2-H05-04-en-02)
Owner	LUOYANG LANDVAC Ti-VIG CO.,LTD Building 1 at the northwest corner of the intersection between Keji Av. and Zhuge St. YIBIN DISTRICT Luoyang City, Henan Province China
Product	Vacuum insulating glazing
Designation	Shipping name: LandVac S1.10 - 8.3+IGU+laminated
Details	Manufacturer LUOYANG LANDVAC Ti-VIG CO.,LTD, - Luoyang City, Henan Province; Overall dimensions (W x H) 1230 mm x 1480 mm; Glass configuration LSG 8 / cavity (Ar) 12 / TSG 4 / Vacuum 0.3 / TSG 4; Thickness 27.8 mm; Surface weight 41.4 kg/m ²
Special features	

Result

Weighted Sound Reduction Index R_w and Spectrum-Adaptation Terms C and C_{tr} according to EN ISO 717-1:2020-12, EN ISO 10140-2:2021-05

$$R_w (C; C_{tr}) = 41 (-2; -6) \text{ dB}$$

Basis *)

EN ISO 717-1:2020-12


EN ISO 10140-1:2021-05

EN ISO 10140-2:2021-05

*) and corresponding national versions
(e.g. DIN EN)

Test report: 25-001320-PR01 PB
T2-H05-04-en-02
replaces Nachweis 25-001320-
PR01 (NW T2-H05-04-en-01)

Representation

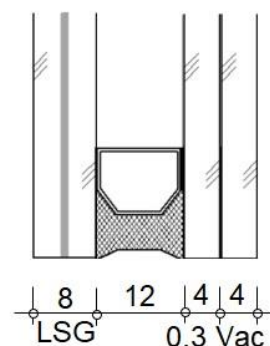

Instructions for use

The results obtained can be used
as evidence in accordance with
the above basis.

Validity

There is no time limit.

When using this document the up-
to-dateness of above basis and
the conformity of the product have
to be observed.

Notes on publication

The ift-Guidance Sheet
"Conditions and Guidance for the
Use of ift-Test Documents"
applies.

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: D44-79816

ift Rosenheim
02.12.2025



Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Acoustics



Andreas Keller, B.Eng.
Operating Testing Officer
Building Acoustics